

OPTIMAL OPERATION OF COMBINED HEAT AND POWER BASED POWER SYSTEMS IN LIBERALIZED POWER MARKETS

Aiying Rong

Technical University of Lisbon, Portugal

Risto Lahdelma

Aalto University, Finland

Keywords: combined heat and power; micro-CHP; microgrid; liberalized power markets; unit commitment; economic dispatch; operation planning; uncertainties; price-taker; decomposition; intelligent techniques; linear programming; mixed integer programming; non-linear programming; stochastic programming; scenario analysis; simulation; risk analysis;

Contents

1. Introduction
 2. CHP systems and liberalized power markets.
 - 2.1. CHP Production Technologies
 - 2.1.1. Steam Turbines
 - 2.1.2. Gas Turbines
 - 2.2. Characteristics of CHP Production
 - 2.3. Impact of Liberalized Power Markets
 3. CHP system modeling
 - 3.1. Framework of CHP System Modeling
 - 3.2. CHP Plant Model
 - 3.2.1. Convex CHP Plant Model
 - 3.2.2. Non-Convex CHP Plant Model
 - 3.2.3. Non-CHP Component Model
 - 3.3. Deterministic Unit Commitment (UC) and Economic Dispatch (ED) Problem Modeling
 - 3.4. Considering Uncertainties in the CHP System
 - 3.4.1. Uncertainties Involved in the CHP System
 - 3.4.2. Modeling Uncertainties in the CHP System
 - 3.4.3. Incorporating Uncertainties in the CHP System Model
 4. Solution approaches to deterministic CHP models
 5. Optimization under uncertainty
 - 5.1. Simulation Optimization
 - 5.2. Scenario Analysis
 - 5.3 Stochastic Optimization
 - 5.4. Fuzzy Optimization
 6. Concluding remarks
- Acknowledgements
Glossary
Bibliography
Biographical Sketches

Summary

In this chapter, we present combined heat and power (CHP) production technologies and related modeling techniques of the CHP plant. Then we discuss the impacts of liberalized power markets on CHP systems and present a typical unit commitment model for a CHP system with different types of components. Next, we provide a comprehensive review on the state-of-art of models and decision support tools for optimizing CHP systems, focusing on how to deal with uncertainties in the liberalized power markets. Finally, we summarize typical solution techniques used in the literature and general requirements for the models and optimization tools in the liberalized power markets.

1. Introduction

Liberalized electric power markets and combined heat and power (CHP) production technologies are actively promoted by extensive political incentives in many countries. Europe has actively incorporated CHP into its energy policy via the CHP Directive (CHP directive, 2004). The US DOE (Department of Energy) has an aggressive goal to raise the share of CHP to 20% of the US generation capacity by the year 2030 (<http://www.aceee.org/policy-brief/combined-heat-and-power-and-clean-distributed-energy-poli>). CHP has also received a good deal of attention by the governments of the developing countries (IEA, 2007). A liberalized power market was introduced in the early eighties in Chile (Del Sol, 2002). Since early nineties, the liberalization has been in progress in the developed countries, including UK, Norway, Sweden, Finland, USA and New Zealand. Currently, the liberalization is going on all over the world. The objective of liberalization of the power market is to achieve higher energy efficiency and lower consumer prices by introducing conditions of intensified commercial competition (Meyer, 2003). CHP production is a leading technology to respond to the market demands. It is also an excellent technology for promoting a fair competition in the liberalized power market. It is a technology for improving efficiency of energy production.

The increasing environmental concerns urge promotion of environmentally sound energy production technologies. Energy policy is giving priority to the problem of global warming. Both energy efficiency and development of new and renewable energy technologies (European Commissions, 2005) are considered key elements for dealing with this problem. The high efficiency of CHP production leads to significant savings in fuel and emissions; typically between 10-40% depending on the technique used and the system replaced (Madlener and Schmid, 2003).

CHP production means the simultaneous production of useful heat and electric power. When steam or hot water is produced for an industrial plant or a residential area, power can be produced efficiently as a by-product. Vice versa, surplus heat from an electric power plant can be used for industrial purposes, or for heating space and water. CHP is considered an environmentally beneficial technology because of its high energy efficiency when compared to conventional condensing power plants. The energy efficiency of a gas turbine is typically between 36-40% when used for power production only, but over 90% if also the heat is utilized.

Traditional CHP can find application in district heating, large commercial and institutional buildings and different industries such as paper, wood, food and semiconductors (Resource Dynamics Corporation, 2001). Recently, micro CHP systems are booming. Micro CHP implements the well established large scale CHP technologies to individual residential houses or small office buildings. In addition, CHP facilities are components of distributed energy resource (DER) systems, which are small-scale power generation technologies used to provide an alternative to or an enhancement of the traditional electric power system. The operation of DER systems is related to microgrids, which are localized groupings of electricity generation, energy storage, and loads that normally operate connected to a traditional centralized grid (macrogrids). The microgrid can function autonomously if it is disconnected from the macrogrid.

Liberalization of the power markets, technological innovation and a growing tendency towards sustainable development becomes an integral part of energy policy planning. New markets and the increased interest in new production technologies will result in a significant change in energy system planning and operation. The energy sector is one of the core application areas in operations research, artificial intelligence techniques and management sciences because energy systems are large and activities associated with operations of the energy systems are complicated. The operation of energy systems is managed based on operational (low-level) production planning.

The goal of production planning in the liberalized power markets is to determine the optimal strategies over a time horizon (day, week, month or year) so that the overall net profit can be maximized subject to production constraints. The production planning can be divided into three levels: Strategic (long-term decisions) such as alliances, long-term contracts and capacity investments; tactical (medium-term decisions) such as maintenance scheduling, fuel allocation, emissions allowance; and operational (short-term decisions) such as unit commitment (UC) and bidding. However, the usage of long-, medium- and short-term planning is a relative term and depends on the application background. E.g., in the UC context, a planning horizon exceeding one week may refer to long-term planning (Thorin, Brand and Weber, 2005; Voorspools and D'haeseleer, 2003).

The complexities of the planning problems vary depending on the scale of the energy systems and information involved in the decision-making. The production planning of the CHP system is inherently more complicated than power-only generation planning. The interdependence between heat and power generation imposes great challenge in production planning. This means that planning must be done in coordination between heat and power. Moreover, the liberalized power market introduces more uncertainties than before. Production planning needs assistance from a wide set of sophisticated modeling, simulation, optimization, and forecasting tools. The necessary optimization methods include linear programming (LP), non-linear programming (NLP), mixed integer programming (MIP) and stochastic programming. The complexity of the problems may also require application of various decomposition techniques such as Lagrangian decomposition, Dantzig-Wolfe decomposition and Benders' decomposition.

Here we intend to introduce the main modeling methods for CHP production technologies and give a comprehensive survey on the state-of-art models and decision

supports tools for the operational planning of the CHP systems in liberalized power markets. We also address optimization under uncertainty. The chapter is organized as follows. In Section 2, we give an overview of CHP production technologies and systems; and how liberalized power markets affect their operation. In Section 3, we give a uniform modeling technique for the components of CHP systems and then present a general deterministic UC model for the CHP system and next discuss how to incorporate uncertainties in the CHP model. In Section 4, we describe the solution approaches for deterministic CHP models. In Section 5, we discuss optimization under uncertainty.

2. CHP Systems and Liberalized Power Markets

Figure 1 shows different types of components of a CHP system in liberalized power markets. The components are roughly classified into four categories:

- Power and heat generation components: These include actual CHP plants, but also separate power and heat production components such as condensing power plants and district heat stations.
- Power and heat storage components such as batteries and hot water tanks
- Power and heat trade components such as various bilateral purchase and sales contracts and
- Power and heat demand side management (DSM) with the target to reduce peak power and heat demand by introducing different tariffs for peak and off-peak energy consumption.

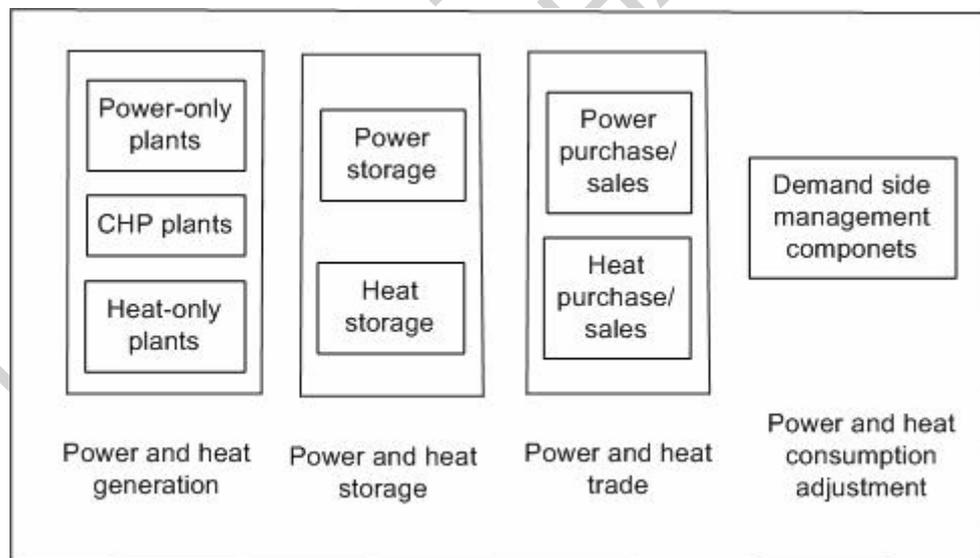


Figure 1. Different types of components of a CHP system in liberalized power markets.

Here it is worth mentioning that renewable energy sources such as solar power, wind power and hydropower can also become components of CHP systems. The inclusion of separate power and heat components makes the system more flexible and reliable under variable demand. In the following, we mainly introduce the conventional CHP production technologies.

2.1. CHP Production Technologies

CHP production technologies are conventional power generation systems with the means to make use of the thermal energy remaining in exhaust gases, cooling systems, or other thermal energy waste stream to improve the overall efficiency of the system. Typical CHP production prime movers include: combustion (gas) turbines, reciprocating engines, boilers with steam turbines, micro-turbines and fuel cells. EPA_CHP (2008) provided a detailed discussion about different CHP technologies. Here we briefly discuss the major characteristics of gas turbines and steam turbines as well as related advanced production technologies. On the one hand, the available sizes of gas turbines and steam turbines are wide: from a few dozen kW to a few hundred MW, covering almost all of the application capacities except micro applications. On the other hand, steam turbines and gas turbines account for a large share of power production capacities for sale to the grid. Power is a high value commodity as compared with heat. Advanced CHP production technologies are developed to improve the power efficiency of CHP production.

2.1.1. Steam Turbines

Steam turbines are widely used for CHP applications in the USA and Europe. Steam turbines are one of the oldest and most versatile prime mover technologies still in general production used to drive a generator or mechanical machinery. Power generation using steam turbines has been in use for about 100 years. Figure 2 shows a schematic boiler/steam turbine system.

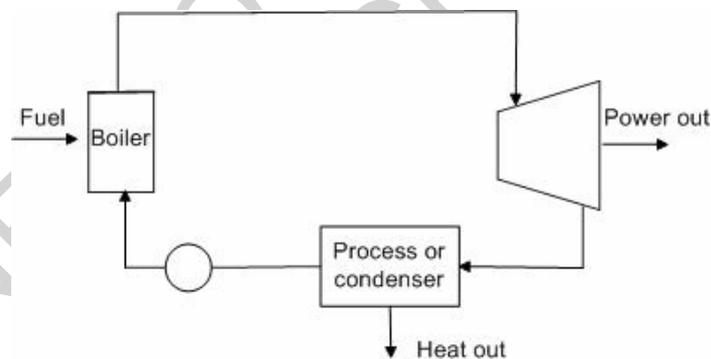


Figure 2. A schematic boiler/steam turbine system.

The thermodynamic cycle for the steam turbine is the Rankine cycle. The cycle consists of a heat source (boiler) that converts water to high pressure steam. The water is first pumped to elevated pressure, which is medium to high pressure depending on the size of the unit and the temperature to which the steam is eventually heated. Then it is heated to boiling temperature corresponding to the pressure, boiled and superheated. The water is eventually transformed into pressurized steam. Next, the pressurized steam is expanded to lower pressure in a multistage turbine, then exhausted either to a condenser at vacuum conditions or into an intermediate temperature steam distribution system that delivers the steam to the industrial or commercial application. The condensate from the condenser or from the industrial steam utilization system is returned to the feed-water pump for continuation of the cycle.

Steam turbines used for CHP can be classified into two main types: backpressure and extraction as shown in Figure 3.

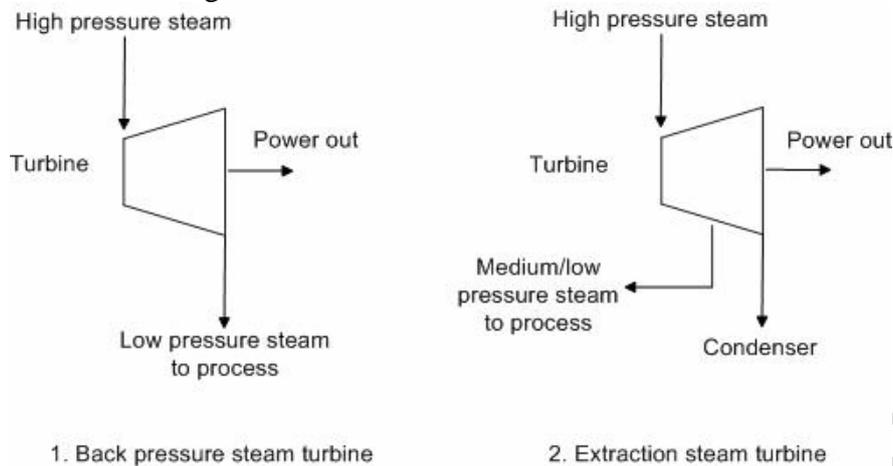


Figure 3. Back pressure and extraction turbines.

The backpressure turbine (Figure 3.1) exhausts its entire flow of steam to the industrial process or facility steam mains at conditions close to the process heat requirements. The exhaust pressure is controlled by a regulating valve to suit the needs of the process steam pressure. The extraction turbine (Figure 3.2) has opening(s) in its casing for extraction of a portion of the steam at some intermediate pressure. The extracted steam may be used for industrial process purpose or sent to boiler feed-water heaters to improve overall cycle efficiency. Extraction flows may be controlled with a valve, or left uncontrolled.

Steam turbines exhaust steam in a partially condensed state, at a pressure well below atmospheric to a condenser when used for purely power generation. Therefore, the traditional steam turbine based power plants are called condensing power plants. Between power (only) output of a condensing steam turbine and combined heat and power output of a backpressure steam turbine, essentially any ratio of power to heat output can be supplied to a facility.

Backpressure steam turbines can be obtained with a variety of backpressure controls, further increasing the variability of the power-to-heat ratio. For the steam turbine based CHP plant, power is a byproduct of heat generation with the system optimized for steam production. Consequently, the power efficiency of the steam turbine based CHP plant is not higher, from 10% to 30%.

However, the overall efficiency is high, approximating the efficiency of the steam boiler (70-90%) depending on operating conditions and age of the boiler. One of the advanced CHP production technologies is the backpressure plants with condensing and auxiliary cooling options to further improve the power efficiency of the steam turbine based CHP plants.

Here it is worth mentioning the role of the boiler for the steam turbine based generation system. The boiler acts as a buffer to separate fuels and the turbines and the fuels are burnt in the boiler. This separation of functions enables steam turbines to operate with

an enormous variety of fuels from solid fuels such as coal, biomass residuals to liquid fuels such as oil to gaseous fuels such as natural gas.

2.1.2. Gas Turbines

As compared with steam turbines, gas turbines operate on the thermodynamic cycle known as the Brayton cycle. Heat is a byproduct of power generation for the gas turbine based CHP system and the power efficiency of the simple cycle gas turbine approximates 40%. The fuel of traditional gas turbine is natural gas. The modern gas turbine has demonstrated distinctive ability to accept a wide variety of gaseous and liquid fuels. To accept solid fuels, a gasifier, which transforms solid fuels into gases, needs to install. Figure 4 shows a schematic gas turbine system.

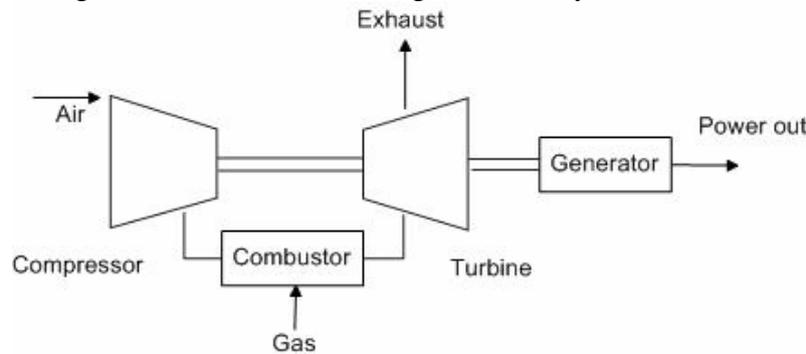


Figure 4. A schematic gas turbine system.

Gas turbine system has an upstream compressor coupled to a downstream turbine with a combustion chamber in-between. In a Brayton cycle, atmospheric air is compressed in a compressor and mixed with gas in the combustor, ignited and heated and then expanded in the turbine to generate power and at the same time exhaust heat. The quality of exhaust heat is high. For a simple cycle CHP application, a heat recovery heat exchanger can be used to recover the heat in the turbine exhaust and converts it to useful thermal energy usually in the form of steam or hot water to satisfy industrial or district heating steam requirements. Alternatively, this high temperature heat can be recuperated to drive a steam turbine in a combined cycle plant so that the efficiency of the power generation can be improved. Combined steam and gas cycle (CSGC) is one of the advanced CHP production technologies with higher power efficiency, which can extract steam at an intermediate pressure for use in industrial processes or district heating. The power efficiency of the CSGC CHP plant approximates 60%.

2.2. Characteristics of CHP Production

There are several characteristics in CHP production, which complicate the operation of a CHP system. First, electric power and heat are two energy commodities in a CHP system. They have one thing in common: they cannot be stored efficiently over a long period of time. Thus, it is necessary to balance supply and demand over a short period of time. Second, because heat cannot be transported economically over a long distance, CHP plants should be located close to where the heat can be consumed and are thus embedded in electricity networks, limiting transmission and distribution losses.

Therefore, heat must be balanced locally over a small area while power can be balanced either locally or globally (over a large area). Finally, interdependence of heat and power generation means that the production planning must be done in coordination.

These characteristics in conjunction with the new production technologies described in Section 2.1 pose challenge over the operation of a CHP system. It requires sophisticated models and efficient solution tools for handling the operation of the system efficiently.

-
-
-

TO ACCESS ALL THE 45 PAGES OF THIS CHAPTER,
Visit: <http://www.eolss.net/Eolss-sampleAllChapter.aspx>

Bibliography

Achayuthakan, C., & Srivastava, S.C. (1998). A genetic algorithm based economic load dispatch solution for eastern region of EGAT system having combined cycle and cogeneration plants. *Proceedings of International Conference on Energy Management and Power Delivery* (pp. 165-170). [This presents a genetic algorithm for CHP ED].

Algie, C., & Wong, K.O. (2004). A test system for combined heat and power economic dispatch problems. *2004 IEEE International Conference on Electric Utility Deregulation, Restructuring and Power Technologies* (vol.1, pp. 96-101). [This presents a test system for the ED problem of a CHP system].

Al-Mansour, F., & Kozuh, M. (2007). Risk analysis for CHP decision making within the conditions of an open electricity market. *Energy*, 32, 1905–1916. [This paper presents a computer model for analysis and economic evaluation of small CHP systems].

Amjady, N., Keynia, F. (2009). Day-ahead price forecasting of electricity markets by mutual information technique and cascaded neuro-evolutionary Algorithm. *IEEE Transactions on Power Systems*, 24(1), 306-318. [This paper presents a hybrid intelligent algorithm for forecasting day-ahead electricity price].

Andersen, A.N., & Lund, H. (2007). New CHP partnerships offering balancing of fluctuating renewable electricity productions. *Journal of Cleaner Production*, 15, 288-293. [This paper presents solutions integrating fluctuating renewable electricity supplies, such as wind power, into electricity systems using small and medium sized CHP plants].

Areekul, P., Senjyu, T., Toyama, H., & Yona, A. (2010). A hybrid ARIMA and neural network model for short-term price forecasting in deregulated market. *IEEE Transactions on Power Systems*, 25(1), 524-530. [This presents a hybrid model for forecasting day ahead electricity prices in the deregulated market].

Arivalagan, A., Raghavendra, B.G., & Rao, A.R.K. (1995). Integrated energy optimization model for a cogeneration based energy supply system in the process industry. *Electrical Power & Energy Systems*, 17, 227-233. [This paper presents a MILP model for optimizing CHP systems in the process industry].

Ashok, S., & Banerjee, R. (2003). Optimal operation of industrial cogeneration for load management. *IEEE Transactions on Power Systems*, 18, 931-937. [This paper presents a generalized formulation to determine the optimal operation strategy of industrial CHP systems and applies NT based method to solve the problem].

Aunedi, M., Škrlec, D., & Štrbac, G. (2008). Optimizing the operation of distributed generation in market environment using genetic algorithms. 14th Mediterranean Electrotechnical Conference (2008). MELECON 2008 (pp. 780-785). [This paper applies GA to optimize the operation of a portfolio of distributed units].

Awad, B., Chaudry, M., Wu, J., & Jenkins, N. (2009). Integrated optimal power flow for electric power and heat in a microgrid. *20th International Conference on Electricity Distribution*. [This paper presents a methodology for optimizing the flow of a small CHP system].

Babu, C.A., & Ashok, S. (2008). Peak load management in electrolytic process industries. *IEEE Transactions on Power Systems*, 23(2), 399-405. [This paper applies a MINLP technique for minimizing electricity cost and reducing the peak load].

Barth, R., Brand, H., Meibom, P., & Weber, C. (2006). A stochastic unit commitment model for the evaluation of the impacts of integration of large amounts of intermittent wind power. *9th International Conference on Probabilistic Methods Applied to Power Systems* (pp.1-8). [This paper applies a stochastic UC model to evaluate the impact of intermittent wind power on the integrated system].

Basu, A. K., Chowdhury, S., & Chowdhury, S.P. (2010a). Distributed energy resource capacity adequacy assessment for PQR enhancement of CHP micro-grid. *IEEE Power and Energy General Meeting* (pp. 1-5). [This paper applies probabilistic methods to evaluate the reliability of CHP based DER capacity].

Basu, A. K., Chowdhury, S., & Chowdhury, S.P. (2010b). Operational management of CHP-based microgrid. *International Conference on Power System Technology* (pp. 1-5). [This paper presents a PSO approach for optimizing a small CHP system].

Bazaraa, M.S. & Shetty, C.M. (1993). *Nonlinear programming theory and algorithms*. NY Wiley, New York. [This book introduces NLP theory and algorithms systematically].

Bellman, R. (1957) *Dynamic Programming*. University Press, Princeton, NJ, USA. [This is a seminal book for introducing DP techniques].

Benders, J.F., (1962). Partitioning procedures for solving mixed-variables programming problems. *Numerische Mathematik*, 4, 238-252. [This is a seminal paper for introducing Benders decomposition methods].

Bengiamin, N.N. (1983). Operation of cogeneration plants with power purchase facilities. *IEEE Transactions on Power Apparatus Systems PAS*, 102(10), 3467-3472. [This paper presents an ED scheme of a CHP system based on the power market mechanism].

Benonysson, A., Bøhm, B., Ravn, H.F. (1995). Operational optimization in a district heating system. *Energy Conversion and Management*, 36(5), 297-314. [This paper presents a mathematical programming approach for optimizing an integrated system including CHP plants and district heat network under the deregulated power market].

Bojic, M., & Stojanovic, B. (1998). MILP optimization of a CHP energy system. *Energy Conversion and Management*, 37, 637-642. [This paper applies MILP approach for optimizing a CHP energy system].

Bos, M.F.J, Beune, R.J.L, & van Amerongen, R.A.M (1996). On the incorporation of a heat storage device in Lagrangian relaxation based algorithms for unit commitment. *Electrical Power & Energy Systems*, 18(4), 205-214. [This paper applies LR based algorithm for dealing with the CHP system with a heat storage device].

Brujic, D., Ristic, M., & Thoma, K. (2007). Optimal operation of distributed CHP Systems for participation in electricity spot markets. *International Conference on "computer as a tool"* (pp. 1463-1469). [This paper presents a tool for optimizing the distributed CHP systems under the deregulated power market].

Caldon, R., Patria, A.R., & Turri, R. (2004). Optimisation algorithm for a virtual power plant operation. *UPEC 2004* (pp. 1058-1062). [This paper presents an optimization algorithm to integrate many DGs into VPP].

Carpaneto, E., Chicco, G., Mancarella, P., & Russo, A. (2008). A risk-based model for cogeneration resource planning. *Probabilistic methods Applied to Power Systems* (pp. 1-6). [This paper deals with the application of the risk-based model to the CHP system].

Carraretto, C., & Lazzaretto, A. (2004). A dynamic approach for the optimal electricity dispatch in the deregulated market. *Energy*, 29, 2273-2287. [This paper presents a DP approach for optimizing ED problem of a CHP system in the deregulated power market].

Carrion, M., & Arroyo, J. M. (2006). A computationally efficient mixed-integer linear formulation for the thermal unit commitment problem. *IEEE Transactions on Power Systems*, 21,1371-1378. [This paper presents a new efficient MILP UC model for power only generation system].

Carrion, M., Philpott, A.B., Conejo, A.J., & Arroyo, J.M. (2007). A stochastic programming approach to electric energy procurement for large consumers. *IEEE Transactions on Power Systems*, 22(2), 744-753.[This paper applies stochastic programming approaches to handle uncertainties of the power prices].

Casella, F., Maffezzoni, C., Piroddi, L., & Pretolani, F. (2001). Minimising production costs in generation and cogeneration plants. *Control Engineering Practice*, 9, 283-295. [This paper presents a mathematical model for dealing with the ED of a CHP system under the deregulated power market].

Catalão, J.P.S., Pousinho, H.M.I., Mendes, V.M.F. (2011). Short-term electricity prices forecasting in a competitive market by a hybrid intelligent approach. *Energy Conversion and Management*, 52, 1061-1065. [This paper presents an approach forecasting electricity prices based on wavelet transform and a hybrid of neural network and fuzzy logic].

Celli, G., Pilo, F., Pisano, G., & Soma, G. G. (2005). Optimal participation of a microgrid to the energy market with an Intelligent EMS. *7th International Power Engineering Conference* (pp. 663-668).[This paper presents a novel EMS based on the application of neural networks].

Chang, H. H. (2011). Genetic algorithms and non-intrusive energy management system based economic dispatch for cogeneration units. *Energy* 36, 181-190. [This paper applies GA to manage energy demand in the optimal ED of a CHP system].

Chang, C.S., & Fu, W., (1998). Stochastic multiobjective generation dispatch of combined heat and power systems. *IEE Proc. Generation, Transmission and Distribution*, 145, 583-591. [This paper applies stochastic multiobjective approach to deal with the demand uncertainties of a CHP system].

Chang, H.H., & Yang, H.T. (2009). Applying a non-intrusive energy-management system to economic dispatch for a cogeneration system and power utility. *Applied Energy*, 86, 2335–2343. [This paper applies GA to the ED of a CHP system].

Chen, B.K., & Hong, C.C. (1996). Optimum operation for a back-pressure cogeneration system under time-of-use rates. *IEEE Transactions on Power Systems*, 11, 1074-1082. [This paper presents a Newton based algorithm to handle the load allocation of a CHP system under time-of-use rates].

Chen, S., Tsay, M., & Gow, H. (2005). Scheduling of cogeneration plants considering electricity wheeling using enhanced immune algorithm. *Electrical Power & Energy System*, 27, 31-38.[This paper presents an enhanced IA to the ED of a CHP system under the deregulated power market].

Chicco, G., & Mancarella, P. (2006). From cogeneration to trigeneration: Profitable alternatives in a competitive market. *IEEE Transactions on Energy Conversion*, 21, 265-272. [This paper discusses the benefit of cogeneration and trigeneration under the deregulated market].

Chicco, G., & Mancarella, P. (2009). Distributed multi-generation: A comprehensive view. *Renewable and Sustainable Energy Reviews*, 13(3), 535-551.[This paper presents a comprehensive review of distributed multi-generation systems from the viewpoint of the sustainability].

CHP Directive (2004). Directive 2004/8/EC of the European Parliament and the Council of 11 February 2004 on the promotion of cogeneration based on a useful heat demand in the internal energy market and amending Directive 92/42/EEC. www.energy.eu/directives/1_05220040221en00500060.pdf. [This is an official document from European Union to promote the CHP technology].

Corso, G., Di Silvestre, M.L., Ippolito, M.G., Sanseverino, E.R., Zizzo, G. (2010). Multi-objective long term optimal dispatch of distributed energy resources in micro-grids. *UPEC 2010* (pp. 1-5). [This paper models the UC problem of then DER system considering multiple objectives such as minimizing generation cost, emissions and line losses].

Daneshi, H., & Daneshi, A. (2008). Price forecasting in deregulated electricity markets – A bibliographical survey. *3rd Conference on Electric Utility Deregulation and Restructuring and power Technologies* (pp.657-661). [This paper presents a brief review and general background of different forecasting methods for short term electricity prices on the market].

Dantzig, G. (1963). *Linear programming and extensions*. Princeton University Press, Princeton, NJ. [This is a classic book for LP techniques].

Del Sol, P. (2002). Responses to electricity liberalization: the regional strategy of a Chilean generator. *Energy Policy*, 30, 437–446. [This paper introduces the situations of electricity liberalization in early eighties in Chile].

Dolgicers, A., Guseva, S., Sauhats, A., Linkevics, O., Mahnitko, A., Zicmane, I. (2009). Market and environmental dispatch of combined cycle CHP plant. *IEEE Bucharest Power Tech Conference* (pp.1-5). [This paper presents an approach for handling combined cycle CHP plants under the deregulated markets and environmental considerations].

Dotzauer, E. (2001). *Energy system operation by Lagrangian Relaxation*. Ph.D. thesis, Department of Mathematics, Linköping University, Sweden. [This is a monograph to handle CHP systems based on LR methods].

Dotzauer, E. (2003). Experiences in mid-term planning of district heating system. *Energy*, 28, 1545-1555. [This paper applies MILP approaches to hand districting heating systems].

Dotzauer, E., & Ravn, H.F. (2000). Lagrangian relaxation based algorithms for optimal economic dispatch of cogeneration systems with a storage. In *proceedings from the second International Conference on Simulation, Gaming, Training and Business Process Reengineering in Operations* (pp. 51-55). Riga, Latvia. [This paper deals with the ED of a CHP system with heat storage based on LR methods].

Dyner, I., & Larsen, E.R. (2001). From planning to strategy in the electricity industry. *Energy Policy* 29, 1145–1154. [This paper presents some fundamental changes in electricity industry from monopoly to liberalization].

Eichhorn, A., & Romisch, W. (2006). Mean-risk optimization models for electricity portfolio management. *9th International Conference on Probabilistic Methods Applied to Power Systems*. [This paper presents a method to handle the uncertainties for electricity portfolio management].

Eichhorn, A., & Romisch, W. (2008). Dynamic risk management in electricity portfolio optimization via polyhedral risk functionals. *IEEE Power and Energy Society General Meeting--Conversion and Delivery of Electrical Energy in the 21st Century* (pp.1-8). [This paper presents a method for combining risk management and optimal planning of power production and trading based on the probability knowledge about the future uncertainties such as demands and prices].

Eichhorn, A., Romisch, W., & Wegner, I. (2005). Mean-risk optimization of electricity portfolios using multiperiod polyhedral risk measures. *IEEE Power Tech* (pp.1-7). [This paper presents a mathematical model with stochastic input data for mean-risk optimization of electricity portfolios].

Eriksen, P.B. (2001). Economic and environmental dispatch of power/CHP production systems. *Electric Power Systems Research*, 57, 33–39. [This paper presents a method for complying with emissions quotas for power or CHP production systems in an economic rational and optimal way].

EPA_CHP. 2008. Catalog of CHP technologies. US environmental protection agency, combined heat and power partnership. www.epa.gov/chp/documents/catalog_chptech_full.pdf [This is a catalog for introducing different CHP production technologies].

European commission, 2005. Commission staff working document. Annex to the communication from commission(2005). The support for electricity from renewable energy sources, impact assessment. COM8(2005) 627 final of 7 December.

http://ec.europa.eu/energy/res/biomass_action_plan/doc/2005_12_07_comm_biomass_electricity_en.pdf . [This is an official document from European Union to support the renewable energy sources].

Faille, D., Mondon, C., & AI-Nasrawi, B. (2007). mCHP optimization by dynamic programming and mixed integer linear programming. *2007 International Conference on Intelligent Systems Applications to Power Systems*. [This paper compares two solution approaches (DP and MILP) for the domestic micro CHP system].

Gardner, D.T. & Rogers, J.S. (1997). Joint planning of combined heat and power and electric power systems: An efficient model formulation. *European Journal of Operational Research*, 102(1), 58-72. [This paper presents an efficient solution approach for a CHP system].

Geidl, M., & Andersson G. (2007). Optimal power flow of multiple energy carriers. *IEEE Transaction on Power Systems*, 22(1), 145-155. [This paper presents an approach for combined coupled power flows of different energy infrastructures such as electricity, gas and district heating systems].

Ghoudjehbakkou, H., & Puttgen, H.B. (1988). Optimum electric utility spot price determinations for small power producing facilities operating under PURPA provisions. *IEEE Transactions on Energy Conversion*, 3(3), 575-582. [This paper presents an optimum spot price determination procedure in the general context of PURPA (public utility regulatory policies act)].

Gómez-Villalva, E., & Ramos, A. (2003). Optimal energy management of an industrial consumer in liberalized markets. *IEEE Transactions on Power Systems*, 18, 716-723. [This paper presents an optimization model for a mid-term management of a thermal and electricity supply system under the deregulated power market].

Gonzalez Chapa, M.A., & Vega Galaz, J.R. (2004). An economic dispatch algorithm for cogeneration systems. *2004 IEEE Power Engineering Society General Meeting*. [This paper presents an algorithm to solve the ED of a CHP system based on SQP and LR].

Gu, W., Wu, Z., & Yuan, X.(2010). Microgrid economic optimal operation of the combined heat and power system with renewable energy. *IEEE Power and Energy Society General Meeting* (pp.1-6). [This paper deals with the problem of economic operation of a CHP system including wind energy, PV, heat recovery boiler and battery].

Guo, T., Henwood, M.I., & van Ooijen, M. (1996). An algorithm for combined heat and power economic dispatch. *IEEE Transactions on Power Systems*, 11, 1778-1784. [This paper presents an algorithm for ED of CHP by decomposing into power dispatch and heat dispatch].

Gustafsson, S.I. (1993). Mathematical modelling of district heating and electricity loads. *Applied Energy*, 46, 149-159.[This paper models the network of district heating and electricity supply].

Handschin, E., Neise, F., Neumann H., & Schultz, R. (2006). Optimal operation of dispersed generation under uncertainty using mathematical programming. *Electrical Power & Energy Systems*, 28, 618–626. [This paper presents a mathematical model for different kinds of dispersed generation with respect to their technical characteristics as well as the optimization technique which is used to solve problems under the existing uncertainty].

Heussen, K., Koch, S., Ulbig, A., & Andersson, G. (2010). Energy storage in power system operation: the power nodes modeling framework. *IEEE PES ISGT (Europe)* (pp. 1-8). [This paper presents a unified approach for modeling non-dispatchable generation and significant storage capacities].

Hernandez-Aramburo, C.A., Green, T.C., & Mugniot, N. (2005). Fuel consumption minimization of a microgrid. *IEEE Transactions on Industry Applications*, 41(3), 673-681. [This paper presents a cost minimization approach of a microgrid consisting of two reciprocating gas engines, a CHP plant, a PV and a wind generator].

Hong, Y.Y., & Li, C.H. (2002). Genetic algorithm based economic dispatch for cogeneration units considering multiplant and multibuyer wheeling. *IEEE Transactions on Power Systems*, 17, 134-140. [This paper presents GA-based algorithms for optimal ED of a CHP system].

Hong Y.Y., & Li C.Y. (2006). Back-pressure cogeneration economic dispatch for physical bilateral contract using genetic algorithms. *2006 International Conference on Probabilistic Methods Applied to Power Systems*. [This paper present a GA with virtual Lagrangian multipliers to enhance the convergence speed to optimality].

Hosseini, S.S.S., Alavi, A.H., Gandomi, A.H. (2011). Combined heat and power economic dispatch by mesh adaptive direct search algorithm. *Expert Systems with Applications*, 38, 6556-6564. [This paper presents an optimization technique called MADS(mesh adaptive direct search) to solve the ED of a CHP system].

Houwing, M., Negenborn, R.R., & De Schutter, B.(2011). Demand response with micro-CHP systems. *Proceedings of the IEEE*, 99(1), 200-213. [This paper investigates to what extent domestic energy cost can be reduced with intelligent, price-based control concepts (demand response)].

Hu, L., Taylor, G., Wan, H., & Irving, M. (2009). A review of short-term electricity price forecasting techniques in deregulated electricity markets. *Proceedings of the 44th International Universities Power Engineering Conference*. [This paper summarizes the influential factors of price behavior, proposes an extended taxonomy of forecasting methods and points out that hybrid methods are the future trends].

Huang, S.H., Chen, B.K., Chu, W.C., & Lee, W.J. (2004). Optimal operation strategy for cogeneration power plants. *Conference Record of the 2004 IEEE Industry Applications Conference*.

IEA (2007). CHP and DHC in China: An assessment of market and policy potential - The international CHP/DHC collaborative. Advancing near-term low carbon technologies. Available at: <http://www.iea.org/g8/chp/profiles/China.pdf>. [This essay summarizes the development of CHP and DHC (district heating and cooling) in China].

Illerhaus, S. W., & Verstege, J. F.(1999). Optimal operation of industrial CHP-based power systems in liberalized energy markets. *IEEE Power Tech'99 Conference*, Budapest, Hungary. [This paper presents the implementation of a new method for the UC of an industrial CHP system and the new method is a dynamic search strategy based on MILP].

Illerhaus, S. W., & Verstege, J. F.(2000). Optimal operation of industrial IPPSs considering load management strategies. *IEEE Industrial Application Conference* (pp. 901-908). [This paper presents a mathematical model representing IPS (industrial power system) to formulate the optimization problem].

Illerhaus, S. W., & Verstege, J. F.(2001). Short-term energy trading considering long-term contract constraints. *IEEE Porto Power Tech'01 Conference*, Porto, Portugal. [This paper presents an approach to coordinate between long term contract and short term energy trading on the day ahead spot energy market].

James & James , 2002. CHP in the United States gaining momentum. Cogeneration and on-site power production 3(4), James & James Science Publishers. http://www.jxj.com/magsandj/cospp/2002_4/chp_usa.html. [This essay introduces the CHP development in USA].

Jamasb, T., & Pollitt, M. (2011). Electricity sector liberalisation and innovation: An analysis of the UK's patenting activities. *Research Policy*, 40, 309-324. [This paper examines the effect of electricity reforms on the patenting activity in the UK electricity sector].

Jablko, R., Saniter, C., Hanitsch, R., & Holler, S.(2005). Technical and economical comparison of micro CHP systems. *International Conference on Future Power System*. [This paper compares different micro CHP systems based on technical and economical factors].

Jafari, S. , Abdolmohammadi, H. R., Nazari, M. E. & Shayanfar, H. A. (2008). A new approach for global optimization in high dimension problems. *Power and Energy Society General Meeting—Conversion and Delivery of Electrical Energy in the 21st Century* (pp.1-7). [This paper presents an improved GA to solve the ED problem with valve loading effects].

Kagiannas, A.G., Askounis, D.T., & Psarras, J. (2004). Power generation planning: a survey from monopoly to competition. *Electrical Power & Energy Systems*, 26, 413-421.[This paper aims to serve as a comprehensive review for generation planning applied in the deregulated power market].

Khorram, E., & Jaberipour, M. (2011). Harmony search algorithm for solving combined heat and power economic dispatch problem. *Energy Conversion and Management*, 52, 1550-1554. [This paper presents a harmony search algorithm for the ED of a CHP system].

Kienzle, F., & Andersson, G. (2010). Location-dependent valuation of energy hubs with storage in multi-carrier energy systems. *7th International Conference on the European Energy Market* (pp.1-6). [This paper presents a valuation method of energy hubs including storage devices and energy hubs is an integrated system of units (CHP plants and batteries), which allows the conversion and storage of multiple energy carriers]

Kim, H-M., & Kinoshita T. (2009). Multiagent system for microgrid operation based on power market environment. *Telecommunication Energy Conference* (pp.1-5). [This paper introduces a power market

model for efficient operation of the microgrid and proposes an agent based mechanism on the power market].

Lahdelma, R. (1994). *An objected-oriented mathematical modeling system*. Ph.D. thesis, Acta, Polytechnica, Scandinavica Mathematics and Computing in Engineering Series No. 66. Systems Analysis Laboratory, Helsinki University of Technology. [This monograph systematically introduces an objected oriented mathematical modeling system for large scale systems].

Lahdelma, R. & Hakonen, H. (2003). An efficient linear programming algorithm for combined heat and power production. *European Journal of Operational Research*, 148, 141-151. [This paper presents an efficient specialized algorithm for a CHP system].

Lahdelma, R. & Makkonen, S., (1996). Interactive graphical object-oriented energy modelling and optimisation. In *Proceedings of the International Symposium of ECOS'96, Efficiency, Cost, Optimisation, Simulation and Environmental Aspects of Energy Systems* (pp. 425-431). June 25-27, Stockholm, Sweden. [This paper applies object-oriented modeling approach to energy systems].

Lahdelma, R., Makkonen, S., & Salminen, P. (2006). Multivariate Gaussian criteria in SMAA. *European Journal of Operational Research*, 170, 957-970. [This paper presents a method for handling dependent uncertainties in a stochastic multicriteria group decision-making problem and demonstrates the use of the method in the context of a strategic decision support model of a retailer operating in the European deregulated power market].

Lahdelma, R. & Rong, A. (2005). Efficient re-formulation of linear cogeneration planning models. In *Proceedings of the 24th IASTED International Conference Modelling, Identification, and Control* (pp. 300-305). ed. M.H. Hamza, February 16 -18, 2005, Innsbruck, Austria. [This paper reformulates the multi-generation plant model based on mass and energy balance into an extremal model].

Lai, L.L., Ma, J.T., & Lee, J.B. (1997). Application of genetic algorithms to multi-time interval scheduling for daily operation of a cogeneration system. *1997 International Conference on Advances in Power System Control, Operation and Management* (pp. 327-331). [This paper applies GA to the ED of a CHP system].

Lai, L.L., Ma, J.T., & Lee, J.B. (1998). Multitime-interval scheduling for daily operation of a two cogeneration system with evolutionary programming. *Electrical power & Energy Systems*, 20, 305-311. [This paper solve the ED of a CHP system based on evolutionary programming].

Larsen, H.V., Palsson, H., & Ravn, H.F. (1998). Probabilistic production simulation including combined heat and power plants. *Electric Power Systems Research*, 48, 45-56. [This paper extends the probabilistic production simulation method to the CHP system].

Lee, J.B., & Jeong, J.H. (2001). A daily optimal operational schedule for cogeneration systems in a paper mill. *2001 Power Engineering Society Summer Meeting* (vol.3, pp. 1357-1362). [This paper presents an evolutionary programming approach for generating a daily operational schedule of a CHP system].

Lee, J.B., Jung, C.H., & Lyu, S.H. (1999). A daily operation scheduling of cogeneration systems using fuzzy linear programming. *1999 IEEE Power Engineering Society Summer Meeting* (vol.2, pp. 983-988). [This paper presents a fuzzy linear programming approach for generating a daily operational schedule of a CHP system].

Lemar P.L. (2001). The potential impact of policies to promote combined heat and power in US industry. *Energy Policy*, 29, 1243-1254. [This paper reviews a portion of the study that examined the impact of the CHP technologies on the US industry and concludes that the policies can be developed to significantly reduce carbon emissions, increase energy efficiency and improve fuel diversity within the US industrial sector with little or no additional cost to US economy].

Linkevics, O., & Sauhats, A. (2005). Formulation of the objective function for economic dispatch optimisation of steam cycle CHP plants. *2005 IEEE Russia Power Tech*. [This paper presents the formulation of optimization problem for the ED of steam cycle CHP plant and polynomial quadratic equations are applied to describe the interrelations between input steam and output heat and power of the steam turbine].

Liu, X. (2010). Combined heat and power dispatch with wind power: a stochastic model and solution. *2010 IEEE Power and Energy Society General Meeting*, 1-6. [This paper presents a model for CHP

dispatch for the system consisting of thermal generators and wind turbines which are of stochastic nature].

Lombardi, P., Powalko, M., & Rudion, K.(2009). Optimal operation of a virtual power plant. *Power and Energy Society General Meeting* (pp.1-6). [This paper introduces and discusses the concept and architecture of a complex virtual power plant and focuses on the optimal operation of the virtual power plant].

MacGregor, P.R., & Puttgen, H.B. (1991). A spot price based control mechanism for electric utility systems with small power producing facilities. *IEEE Transactions on Power Systems*, 6(2), 683-690. [This paper presents a spot price determination procedure in the context of small power producing facility].

Madlener, R. & Schmid, C. (2003). Combined heat and power generation in liberalized markets and a carbon-constrained world. *Sustainable Energy Provision*, GAIA 12, 114-120. [This paper discusses the strength of CHP technology in liberalized market and carbon-constrained condition].

Maifredi, C., Puzzi, L., & Beretta, G.P. (2000). Optimal power production scheduling in a complex cogeneration system with heat storage. *Proceedings of 35th Intersociety Energy Conversion Engineering Conference*. [This presents a DP approach for a CHP system].

Makkonen, S. (2005). *Decision modeling tools for utilities in the deregulated energy market*. Ph.D. thesis, Research Report A93, Systems Analysis Laboratory, Helsinki University of Technology. [This monograph analyzes the different requirements for planning and optimization of energy systems between monopoly and deregulated market and presents decision support tools for utilities in the deregulated market].

Makkonen, S. & Lahdelma, R. (1998). Stochastic simulation in risk analysis of energy trade. Trends in Multicriteria Decision Making: In *Proceedings of 13th International Conference on Multiple Criteria Decision Making* (pp. 146-156). Springer. [This paper applies stochastic simulation to deal with the energy trade and related risk analysis on the basis of solving deterministic optimization model].

Makkonen, S. & Lahdelma, R. (2001). Analysis of power pools in the deregulated energy market through simulation. *Decision Support Systems*, 30(3), 289-301. [This paper analyzes the risk of power trade in the deregulated market by solving deterministic optimization problem in conjunction with stochastic simulation].

Makkonen, S. & Lahdelma, R. (2006). Non-convex power plant modelling in energy optimisation, *European Journal of Operational Research*, 171, 1113-1126. [This paper presents a model for the CHP system including non-convex plant and develops a specialized BB algorithm to solve the problem].

Makkonen, S., Lahdelma, R., Asell, A.M., & Jokinen, A. (2003). Multi-criteria decision support in the liberated energy market. *Journal of Multi-Criteria Decision Analysis*, 12(1), 27-42. [This paper presents multi-criteria decision support tools to the energy system in the deregulated power market].

Mao, M, Ji , M., Dong, W., & Chang, L. (2010). Multi-objective economic dispatch model for a microgrid considering reliability. *2010 2nd IEEE Symposium on Power Electronics for Distributed Generation Systems* (pp. 993- 998). [This paper presents a PSO algorithm to solve the multi-objective ED model for a microgrid to minimize production cost, customer outage cost and emission cost]

Manolas, D.A., Frangopoulos, C.A., Gialamas, T.P., & Tsahalis, D.T. (1997). Operation optimization of an industrial cogeneration system by a genetic algorithm. *Energy Conversion and Management*, 38, 1625-1636. [This paper presents a GA for solving the ED of a CHP system].

Maranas, C.D., Androulakis, I.P., Floudas, C.A., Berger, A.J., & Mulvey, J.M. (1997). Solving long-term financial planning problems via global optimization. *Journal of Economic Dynamics and Control*, 21, 1405-1425. [This paper presents a global optimization algorithm for the multi-stage dynamic problem]

Marechal, F., & Kalitventzeff, B. (1998). Process integration: Selection of the optimal utility system. *Computers & Chemical Engineering (Supplementary)*, 22, S149-S156. [This paper presents a hybrid approach for combining MILP approach with expert system to determine the best combination of different energy production technologies].

Marriott, K., & Stuckey, P. J. (1998). *Programming with constraints*. MIT Press. [This book introduces constraint programming techniques].

Marshman, D.J. , Chmelyk, T., Sidhu, M.S., Gopaluni, R.B., Dumont, G.A. (2010). Energy optimization in a pulp and paper mill cogeneration facility. *Applied Energy*, 87, 3514–3525. [This paper presents an optimization algorithm for a CHP system in the pulp and paper mill].

Matics, J., & Krost, G. (2007). Computational intelligence techniques applied to flexible and auto-adaptive operation of CHP based home power supply. *2007 International Conference on Intelligent Systems Applications to Power Systems* (pp. 1-7).[This paper discusses the application of computational intelligence techniques to improve the performance of micro CHP systems].

Mavrotas, G., Demertzis, H., Meintani, A., & Diakoulaki, D. (2003). Energy planning in buildings under uncertainty in fuel costs: The case of a hotel unit in Greece. *Energy Conversion and Management*, 44, 1303 -1321. [This paper applies fuzzy logic to deal with uncertainties for energy planning].

Mavrotas, G., Diakoulaki, D., Florios, K., & Georgiou, P. (2008). A mathematical programming framework for energy planning in services' sector buildings under uncertainty in load demand: The case of a hospital in Athens. *Energy Policy*, 36, 2415-2429. [This paper presents an integrated modelling and optimization framework for energy planning in large consumers of the service sector based on mathematical programming and uncertainties are handled by fuzzy logic].

Mavrotas, G., Florios, K., & Vlachou, D.(2010). Energy planning of a hospital using mathematical programming and Monte Carlo simulation for dealing with uncertainty in the economic parameters. *Energy Conversion and Management*, 51, 722–731.[This paper deals with uncertainty by combining MILP approach and stochastic simulation].

Mazur, V. (2007). Fuzzy thermo-economic optimization of energy-transforming systems. *Applied Energy*, 84, 749-762. [This paper applies fuzzy multi-objective techniques to handle the optimization of energy transforming systems with conflict objectives].

Meibom, P., Kiviluoma, J., Barh, R., Brand, H., Weber, C., & Larsen, H.V. (2007). Value of electric heat boiler and heat pumps for wind power integration. *Wind Energy*, 10, 321-327. [This paper analyzes an integrated system including wind power based on stochastic programming techniques].

Menniti, D., Pinnarelli, A., & Sorrentino, N. (2009). Operation of decentralized electricity market in microgrids. *20th International Conference on Electricity Distribution* (pp.1-4). [This paper presents a scheme to implement a local microgrid market linked to the macrogrid market].

Meyer, N.I. (2003). European schemes for promoting renewables in liberalized markets. *Energy Policy*, 31, 665–676. [This paper describes possibilities and problems for penetration of supply system based on renewable energy sources in liberalized markets].

Milo, A., Gaztañaga, H., Etxeberria-Otadui, I., Bilbao,E., & Rodríguez, P. (2009). Optimization of an experimental hybrid microgrid operation: reliability and economic issues. *IEEE Bucharest Power Tech Conference*. [This paper applies simulation technique to optimize and analyze an experimental hybrid microgrid].

Morais, H., Vale, Z.A., Ramos, C., & Praça, I. (2009). Virtual power producers simulation – negotiating renewable distributed generation in competitive electricity markets. *IEEE PES/IAS Conference on Sustainable Alternative Energy* (pp. 1-8). [This paper presents a simulation tool to simulate the operation of virtual power producers]

Moslehi, K., Khadem, M., Bernal, R., & Hernandez, G. (1991). Optimization of multiplant cogeneration system operation including electric and steam networks. *IEEE Transactions on Power Systems*, 6, 484-490.[This paper presents applies coordination technique to the ED of a CHP system].

Mulvey, J.M., & Shetty, B. (2004). Financial planning via multi-stage stochastic optimization. *Computers & Operations Research*, 31, 1-20. [This paper presents a framework for modelling planning problems based on multi-stage optimization under uncertainty].

Neogi, S., Pradhan, A., Sinha, A., Chowdhury, S. Chowdhury, S.P., Gaunt, C.T.(2009). Optimizing generation portfolio for emission control in Europe's utilities. *6th International Conference on European Energy Market* (pp. 1-9). [This paper presents a method to generators for optimizing its operations under emission control].

Nguyen, M.Y., Yoon, Y.T., & Choi, N.H. (2009). Dynamic programming formulation of micro-grid operation with heat and electricity constraints. *Asia and Pacific Transmission & Distribution Conference & Exposition* (pp. 1-4). [This paper applies DP technique to micro-grid operations].

Niknam, T. (2006). An approach based on particle swarm optimization for optimal operation of distribution network considering distributed generators. *32nd Annual Conference on IEEE Industrial Electronics* (pp. 633-637). [This paper applies PSO technique to the operation of distributed generators].

Niu, D., Liu, D., Wu, D.D., (2010). A soft computing system for day-ahead electricity price forecasting. *Applied Soft Computing*, 10, 868–875. [This paper presents a technique to forecast electricity prices based on self organizing map neural network and support vector machine].

Nord Pool, 2004. Nord Pool Statistics. [This presents statistics for electricity prices in Nordic pool power market]

Ozturk, U.A. (2003). *The stochastic unit commitment problem: a chance constrained programming approach considering extreme multivariate tail probabilities*. Ph.D. thesis, University of Pittsburgh. [This monograph presents a chance constrained programming approach to deal with the UC problem of the power only generation system under uncertainty].

Palsson, O.P., & Ravn, H.F. (1994). Stochastic heat storage problem -- Solved by the progressive hedging algorithm. *Energy Conversion and Management*, 35(12), 1157-1171. [This paper presents a technique for solving a CHP system with storage under uncertain].

Paravan, D., Brand, H., Golob, R., Hlouskova, J., Kossmeirer, S., Madlener, R., Merse, S., Obersteiner, M., Stanicic, D., Stokel, T., Urbancic, A., & Weber, C. (2002). Optimization of CHP plants in a liberalised power system. *2002 BPC conference*, 219-226. [This paper deals with uncertainties on the market based on stochastic programming approach].

Piperagkas, G.S., Anastasiadis, A.G., Hatziargyriou, N.D. (2011). Stochastic PSO-based heat and power dispatch under environmental constraints incorporating CHP and wind power units. *Electric Power Systems Research*, 81, 209-218. [This paper solves the stochastic programming model for the ED problem of a CHP system by PSO technique].

Pribicevic, B., Krasenbrik B., & Haubrich, H.J. (2002). Co-generation in a competitive market. *IEEE Power Engineering Society Summer Meeting* (vol.1, pp. 422-426). [This paper presents a method for optimal planning of both generation and market activities in a municipal CHP system].

Prousch, S., Breuer, C., & Moser, A. (2010). Optimization of decentralized energy supply systems. *7th International Conference on European Energy Market* (pp. 1-6). [This paper presents a method for optimizing the operation of energy supply system based on a detailed model of new network customers].

Prousch, S., Breuer, C., Zhao, L., Hübner, M., & Moser, A. (2010). Operational Optimization of Municipal Energy Supply Systems. *2010 IEEE Power and Energy Society General Meeting* (pp. 1-8). [This paper presents a method to optimize the municipal energy system without extending the existing distribution grid to achieve minimum operational cost].

Puttgen, H.B., & MacGregor, P.R. (1989). Optimum scheduling procedure for cogenerating small power producing facilities. *IEEE Transactions on Power Systems*, 4(3), 957-964. [This paper presents a LP method for solving the ED of a small CHP system].

Ramirez-Elizondo, L.M., Paap, G.C. (2009). Unit commitment in multiple energy carrier systems. *North American Power Symposium* (pp. 1-6). [This paper presents a general UC framework for energy systems containing multiple energy carriers].

Ramirez-Elizondo, L.M., Velez, V., & Paap, G.C. (2010). A technique for unit commitment in multiple energy carrier systems with storage. *9th International Conference on Environment and Electrical Engineering* (pp. 106-109). [This paper presents a technique to include storage devices as part of a general UC framework for energy systems containing multiple energy carriers].

Ravn, H.F., Riisom, J., & Schaumburg-Muller, C. (2005). A stochastic unit commitment model for a local CHP plant. *2005 IEEE Power tech, Russia*, 1-7. [This paper presents a UC model for a local CHP system based on stochastic programming].

Razali, N. M. M., & Hashim, A.H. (2009). Microgrid operational decisions based on CFaR with Wind Power and pool prices uncertainties. *Proceedings of the 44th Universities Power Engineering Conference* (pp.1-5). [This paper applies stochastic simulation to evaluate the ratio of expected profit to expected cost of energy procurement, cash flow at risk and expected shortfall].

Resource Dynamics Corporation (2001), Assessment of replicable innovative industrial cogeneration applications. [This provides a comprehensive analysis of CHP technologies and applications].

Rifaat R.M. (1997). Practical considerations in applying economical dispatch models to combined cycle cogeneration plants. *IEEE WESCANEX 97 Communications, Power and Computing* (pp. 59-63). [This paper presents a method for including combined cycle CHP plant in the ED problem].

Rifaat, R.M. (1998). Economic dispatch of combined cycle cogeneration plants with environmental constraints. *Proceedings of International Conference on Energy Management and Power Delivery* (vol.1, pp. 149-153). [This paper evaluates ED models for combined cycle CHP plants with environmental constraints based on Lagrangian and KKT approach].

Rolfsman, B. (2004). Combined heat-and-power plants and district heating in a deregulated electricity market. *Applied Energy*, 78, 37-52. [This paper presents a method for optimizing a CHP system with heat storage under a deregulated market].

Rong, A. (2006). *Cogeneration planning under the deregulated power market and emissions trading scheme*. Ph.D. thesis, ISBN 951-29-3057-9, University of Turku, Turku Center for Computer Science, Turku, Finland. [This monograph presents models and optimization techniques for CHP and trigeneration planning problem under the deregulated power market and emission trading market].

Rong, A., Hakonen, H., & Lahdelma, R. (2006). An efficient linear model and optimisation algorithm for multi-site combined heat and power production. *European Journal of Operational Research*, 168(2), 612-632. [This paper presents an efficient model and specialized optimization algorithm for a multi-site CHP system].

Rong, A., Hakonen, H., & Lahdelma, R. (2008). A variant of the dynamic programming algorithm for the unit commitment of combined heat and power systems. *European Journal of Operational Research*, 190, 741-755. [This paper presents a DP algorithm for the UC model of a CHP system based on linear relaxation of ON/OFF states of plants and sequential commitment of units one by one]

Rong, A., Hakonen, H., & Lahdelma, R. (2009). A dynamic regrouping based sequential dynamic programming algorithm for unit commitment of combined heat and power systems. *Energy Conversion and Management*, 50, 1108-1115. [This paper improves a heuristic DP approach for the UC problem of a CHP system by dynamic regrouping the CHP plants].

Rong, A., Hakonen, H., Makkonen, S., Ojanen, O., & Lahdelma, R. (2004). CO₂ emissions trading optimization in combined heat and power generation. In P. Neittaanmäki, T. Rossi, K. Majava, O. Pironneau (eds) *Proc. ECCOMAS 2004*. [This paper deals with emissions trading optimization based on a specialized model for the CHP system].

Rong, A. & Lahdelma, R. (2005a). Risk analysis of expansion planning of combined heat and power energy system under emissions trading scheme. In *proceedings of IASTED International Conference on Energy and Power Systems* (pp. 70-75). Worawit Tayati (eds), April 18-20, 2005, Krabi, Thailand. [This paper presents a method of risk analysis for expansion planning of a CHP system based on solving deterministic planning problems and stochastic simulation].

Rong, A. & Lahdelma, R. (2005b). An efficient model and specialized algorithms for cogeneration planning. In *Proceedings of the IASTED International Conference Energy and Power System* (pp. 1-7). ed. W. Tayati, April 18-20, 2005, Krabi, Thailand. [This paper presents a brief review of specialized algorithms for CHP and trigeneration planning].

Rong, A. & Lahdelma, R. (2007a). CO₂ emissions trading planning in combined heat and power production via multi-period stochastic optimization. *European Journal of Operational Research*, 176, 1874-1895. [This paper deals with CO₂ emissions trading planning of a CHP system based on scenario analysis and simulation].

Rong, A. & Lahdelma, R. (2007b). Efficient algorithms for combined heat and power production planning under the deregulated electricity market, *European Journal of Operational Research*, 176, 1219-

1245. This paper presents specialized algorithms for the planning problem of a convex CHP system based on the special problem structure under the deregulated power market].

Rong, A. & Lahdelma, R. (2007c). An efficient envelope-based Branch and Bound algorithm for non-convex combined heat and power production planning. *European Journal of Operational Research*, 183, 412-431. [This paper presents specialized BB algorithms for the planning problem of a CHP system including non-convex plants based on the special problem structure under the deregulated power market].

Rong, A. & Lahdelma, R. (2007d). An effective heuristic for combined heat and power production planning with power ramp constraints. *Applied Energy*, 84, 307-325. [This paper presents a method for dealing with ramp constraints based on the solution to the problem with relaxed ramp constraints].

Rong, A., Lahdelma, R., & Grunow, M. (2009). An improved unit decommitment algorithm for combined heat and power systems. *European Journal of Operational Research*, 195, 552-562. [This paper presents a unit decommitment algorithm to solve the UC model of a CHP system starting with an improved initial schedule with less heat surplus].

Rong, A., Lahdelma, R., & Grunow, M. (2010). Poly-generation planning: useful lessons from models and decision support tools (Book Chapter), pp 296-335, in the book “*Intelligent Information Systems and Knowledge Management for Energy: Applications for Decision Support, Usage and Environmental Protection*” (eds Kostas, Metaxiotis), IGI global publisher. [This chapter provides a comprehensive review of poly-generation planning at different decision levels].

Rooijers, F.J., & van Amerongen, R.A.M. (1994). Static economic dispatch for co-generation systems. *IEEE Transactions on Power Systems*, 9, 1392-1398. [This paper presents a dual programming approach for the ED of a CHP system].

Salgado, F., & Pedrero, P. (2008). Short-term operation planning on cogeneration systems: A survey. *Electric Power Systems Research*, 78, 835–848. [This paper mainly gives a survey for ED of short-term operation planning of CHP systems].

Seeger, T., & Verstege, J. (1991). Short term scheduling in cogeneration systems. *1991 Power Industry Computer Application Conference* (pp. 106-112). [This paper applies MILP approach for dealing with UC problem of a CHP system].

Schulz, C., Roder, G., & Kurrat, M. (2005). Virtual power plants with combined heat and power micro-units. *International Conference on Future Power Systems* (pp.1-5). [This paper presents a method for integrating micro CHP units into the low voltage network].

Schultz, R., & Neise, F. (2006). Algorithms for mean-risk stochastic integer programs in energy. *IEEE Power Engineering Society General Meeting*. [This paper presents decomposition algorithms for including risk aversion into stochastic programming problem in energy].

Sinha, N., & Bhattacharya, T. (2010). Genetic algorithms for non-convex combined heat and power dispatch problems. *TENCON 2008-2008 IEEE Region 10 Conference* (pp. 1-5). [This paper presents GAs the ED of a CHP system including non-convex plants].

Song, Y.H., Chou, C.S., & Stonham, T.J. (1999). Combined heat and power economic dispatch by improved ant colony search algorithm. *Electric Power Systems Research*, 52, 115-121. [This paper presents AC algorithm for the ED of a CHP system].

Su, C.H., & Chiang, C.L. (2004). An incorporated algorithm for combined heat and power economic dispatch. *Electric Power Systems Research*, 67, 187-195. [This paper presents a GA algorithm for the ED of a CHP system].

Subbaraj, P., Rengaraj, R., Salivahanan, S. (2009). Enhancement of combined heat and power economic dispatch using self adaptive real-coded genetic algorithm. *Applied Energy*, 86, 915–921. [This paper presents a GA algorithm for the ED of a CHP system].

Sudhakaran, M., & Slochanal, S.M.R. (2003). Integrating genetic algorithms and tabu search for combined heat and power economic dispatch. *Conference on Convergent Technologies for the Asia-Pacific Region*. [This paper deal with the ED of a CHP system by combining GA and TS].

Sudhakaran, M., Vimal Raj, P.A.D., & Palanivelu, T.G. (2007). Application of particle swarm optimization for economic load dispatch problems. *2007 International Conference on Intelligent Systems Applications to Power Systems*. [This paper applies PSO to deal with the ED of a CHP system].

Sun, Y., Wu, F.F., & Zhou, H. (2010). Power portfolio optimization with traded contract products. *IEEE Power and Energy Society General Meeting* (pp.1-6). [This paper deals with power portfolio optimization using conditional value at risk as the risk measure].

Surdu, C., Hadjsaid, N., Kieny, C., & Caire, R. (2005). Combined heat and power plant optimization tool in a competitive energy market context. *18th International Conference on Electricity Distribution*. [This paper presents a comprehensive optimization tool for the local trading strategies of CHP plant].

Takriti, S., Krasenbrink, B., & Wu, L.S.Y. (2000). Incorporating fuel constraints and electricity spot prices into stochastic unit commitment problem. *Operations Research*, 48(2), 268-280. [This paper deals with UC problem of a power only generation system under uncertainty based on scenario analysis and the resulting model is solved by LR and bender's decomposition].

Thomson, M., & Infield, D.G. (2007). Network power flow analysis for a high penetration of distributed generation. *IEEE Transactions on Power Systems*, 22(3), 1157-1162. [This paper presents a method to analyze the impact of high penetration of distributed generators on the operation of distribution systems].

Thorin, E., Brand, H., & Weber, C. (2005). Long-term optimization of cogeneration systems in a competitive market environment. *Applied Energy*, 81, 152-169. [This paper presents a method for dealing with long term UC problem of a CHP system based on MILP and LR].

Tsay, M.T. (2003). Applying the multi-objective approach for operation strategy of cogeneration systems under environmental constraints. *Electrical Power & Energy systems*, 25, 219-226. [This paper presents a multi-objective approach based on EP to solve the ED of a CHP system].

Tsay, M.T., Chang, C.Y., & Gow, H.J. (2004). The operational strategy of cogeneration plants in a competitive market. *2004 IEEE Region 10 Conference*. [This paper presents an operational strategy for CHP plants in a competitive market based on IA].

Tsay, M.T., & Lin, W.M. (2000). Application of evolutionary programming to optimal operational strategy cogeneration system under time-of-use rates. *Electrical Power & Energy systems*, 22, 367-373. [This paper present an EP approach to solve the ED of a CHP system under time-of-use rates].

Tsay, M.T., Lin W.M., & Lee, J.L. (2001a). Interactive best-compromise approach for operation dispatch of cogeneration systems. *IEE proc. Generation, Transmission, Distribution*, 148 (4), pp. 326-332. [This paper presents an Interactive best-compromise approach based on EP to solve the ED of a CHP system].

Tsay, M.T., Lin, W.M., & Lee, J. L. (2001b). Application of evolutionary programming for economical dispatch of cogeneration system under emission constraints. *Electrical Power & Energy systems*, 23, 805-812. [This paper present an EP approach to solve the ED of a CHP system under emission constraints].

Tseng C.L., Oren, S.S., Svoboda, A.J., & Johson, R.B. (1997). A unit decommitment method in power system scheduling. *Electrical Power & Energy Systems*, 19, 357-65. [This paper presents a unit decommitment method for the UC problem of a power only generation system].

Tsikakakis, A.G., & Hatziargyriou, N.D. (2008). Centralized control for optimizing microgrids operation. *IEEE Transactions on Energy Conversion*, 23(1), 241-248. [This paper describes the operation of central controller for microgrids].

Tsukada, T., Tamura, T., Kitagawa, S., & Fukuyama, Y. (2003). Optimal operational planning for cogeneration system using particle swarm optimization. *Proceedings of the 2003 IEEE Swarm Intelligence Symposium* (pp. 138-143). [This paper presents a PSO approach for the operational planning problem of a CHP system].

Ummels, B.C., Gibescu, M., Pelgrum, E., Kling, W.L., & Brand, A.J. (2007). Impacts of wind power on thermal generation unit commitment and dispatch. *IEEE Transactions on Energy Conversion*, 22, 44-51. [This paper presents an approach for UC problem of a distributed generation system based on stochastic simulation].

Unsihuay-Vila, C., Zambroni de Souza, A.C., Marangon-Lima, J.W., & Balestrassi P.P. (2010). Electricity demand and spot price forecasting using evolutionary computation combined with chaotic

nonlinear dynamic model. *Electrical Power and Energy Systems*, 32, 108-116. [This paper presents a hybrid approach for forecasting electricity prices based on evolutionary computation and chaotic nonlinear dynamic model].

Vasebi, A., Fesanghary, M., & Bathaee, S.M.T. (2007). Combined heat and power economic dispatch by harmony search algorithm, *Electrical power & Energy system*, 29, 713-719. [This paper presents a harmony search approach for CHP dispatch].

Venkatesh, B.N., & Changkong, V.(1995). Decision models for management of cogeneration plants. *IEEE Transactions on Power Systems*, 10, 1250-1256. [This paper focuses on development of modeling tools for optimal energy management in an industrial/commercial setting with CHP plants].

Ventosa, M., Baillo, A., Ramos, A., & Rivier, M. (2005). Electricity market modeling trends. *Energy Policy*, 33, 897-913. [This paper presents a survey of the most relevant publications regarding electricity market modeling].

Voorspools, K.R. & D'haeseleer, W.D. (2003). Long-term unit commitment optimization for large power systems: unit decommitment versus advanced priority listing. *Applied Energy*, 76, 157-167. [This paper compares unit decommitment approach and advanced priority listing approach for long-term unit commitment optimization including CHP plants].

Wang, L., & Singh, C. (2008). Stochastic combined heat and power dispatch based on multi-objective particle swarm optimization. *Electrical power & Energy system*, 30, 226-234. [This paper solves the stochastic CHP dispatch using multi-objective based PSO].

Weber, C., & Woll, O. (2006). Valuation of CHP power plant portfolios using recursive stochastic optimization. *9th International Conference on Probabilistic Methods Applied to Power Systems* (pp. 1-6). [This paper presents a recursive stochastic optimization approach for valuing CHP plants].

Wong, K.P., & Algie, C. (2002). Evolutionary programming approach for combined heat and power dispatch. *Electric Power Systems Research*, 61, 227-232. [This paper presents EP approach for the CHP dispatch].

Wu, Y.J., & Rosen, W.A. (1999). Assessing and optimizing the economic and environmental impacts of cogeneration/district energy systems using an energy equilibrium model. *Applied Energy*, 62, 141-154. [This paper evaluates and optimizes a CHP system based on an energy equilibrium model].

Wu, L., & Shahidehpour, M. (2010). A hybrid model for day-ahead price forecasting. *IEEE Transactions on Power Systems*, 25(3), 1519-1529. [This paper presents a hybrid time series and adaptive wavelet neural network model for forecasting electricity price].

You, S., Traholt, C., & Poulsen, P.(2009). A market-based virtual power plant. *International Conference on Clean Electric Power* (pp. 460-465). [This paper presents a market-based virtual power plant which provides individual DER units accesses to the current electricity market].

Youn, L.T., & Leem, K.T. (2005). Stochastic models for operation of bottoming-cycle cogeneration facility. *International Conference on Future Power System* (pp.1-5). [This paper presents a stochastic model for the operation of an on-site bottoming-cycle CHP plant].

Zadeh, L.A. (1978). Fuzzy sets a basis for a theory of possibility. *Fuzzy Sets and Systems*, 1, 3–28. [This is a fundamental paper for the theory of possibility].

Biographical Sketches

Aiying Rong received her master degree in Industrial Engineering and Engineering Management at Hong Kong University of Science and Technology and her Ph.D. degree in Computer Science (Algorithmics) at the University of Turku, Finland. During her PhD study, she was mainly involved in research on cogeneration planning under the deregulated power market and emissions trading scheme. Currently, she is working as a FCT research fellow in Cemapre (Centers for Applied Mathematics and Economics) at ISEG- Technical University of Lisbon, Portugal. Her research interests include operations, planning and scheduling of production activities in different industrial sectors such as the energy industry, the food industry, and the iron & steel industry. She has published papers in *European Journal of Operational Research*, *International Journal of Production Research*, *International Journal of Production Economics*,

OR Spectrum, Journal of the Operational Research Society, Transportation Research Part E, Computers & Industrial Engineering, International Journal of Advanced Manufacturing Technology, Applied Energy and Energy Conversion and Management. Her email address is arong@iseg.utl.pt.

Risto Lahdelma received his PhD at Helsinki University of Technology, Finland in 1994. Since 2000, he has been a full professor of computer science at University of Turku, Finland. He is currently the chairman of the Finnish Operations Research Society. His research interests include systems and operations research, energy management, intelligent systems, embedded algorithms and multi-criteria decision support. He has published papers in Operations Research, European Journal of Operational Research, Journal of Environmental Management, Environmental Management, Journal of Multi-Criteria Decision Analysis, Decision Support Systems, International Journal of Advanced Manufacturing Technology Applied Energy, Energy Conversion and Management, Socio-Economic Planning Science, Forest Policy and Economics. His email address is risto.lahdelma@tkk.fi.

UNESCO – EOLSS
SAMPLE CHAPTERS